



FieldServer Driver - Serial FS-8700-23 CB Link

Description

The CB-Link driver allows the FieldServer to transfer data to and from devices over RS-485 using CB-Link protocol. Refer to "Model 833-2771 CB-Link" Manual #65-0216 and "Model 833-2757 General Purpose Interface ControlBus Module" Manual #65-0220 from Cleaver Brooks.

Command/SubCommand Supported:

Formal Driver Type

Serial
Server Only

Connection Information

Connection type: RS-485
Baud Rates: 9600
Parity: None

Devices tested

Device	Tested (FACTORY, SITE)
Cleaver Brooks Hawk, EC78XX Honeywell Link	SITE

The FieldServer can accept any information transmitted by the CB Hawk, including:

- Program, operate, auto, man, rem modes
- Flame failure
- Gas pressure Sensor high/low
- Fuel selection
- Atomizing air off
- Steam pressure, water temperature, oil pressure sensor information
- Lockout and pre-ignition interlock
- AC line frequency
- Excess AC line noise
- Damper motor
- Replace battery
- Fuel selection, recycle limits, oil pressure, oil temperature, lockout/interlock, open oil drawer hold
- Standby, prepurge, pilot ignition, fuel change, main ignition, run, post purge, safety shutdown
- Low fire cutoff, flame detected, test switch, damper motor holds
- Call CB service.

FieldServer Technologies, 1991 Tarob Court, Milpitas, CA 95035 USA


■ Tel: 408-262-2299, ■ Fax: 408-262-9042 ■ Toll-Free: 888-509-1970

Email: sales@fieldserver.com

Website: www.fieldserver.com



Connection configurations

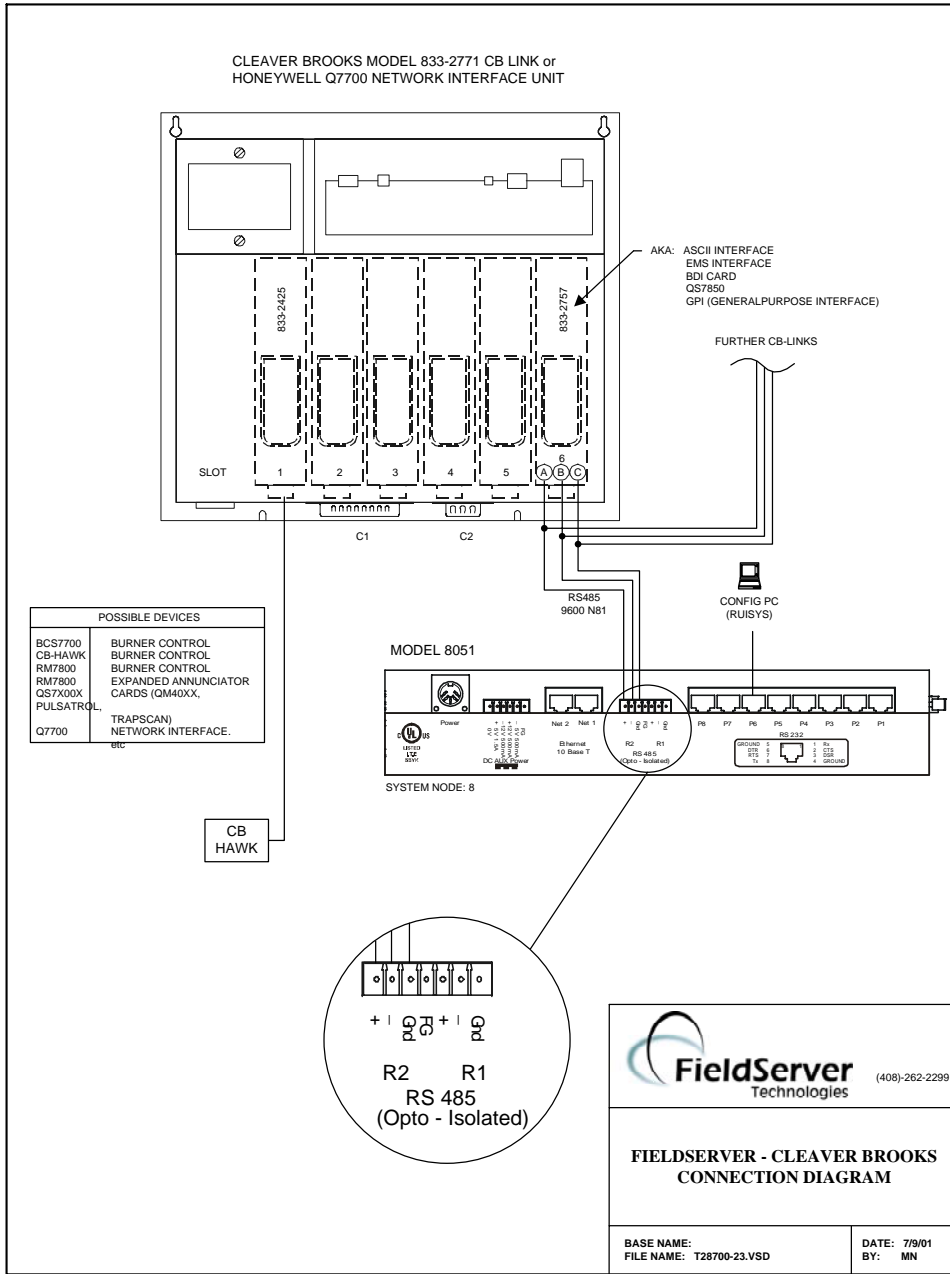



Device Information Table

NETWORK INTERFACE UNIT					
MAKE	MODEL	NAME			
Honeywell	Q7700	Network Interface Unit			
Cleaver Brooks	833-2771	CB-Link			
CONTROL MODULES					
MAKE	MODEL No. OF MODULE	MODULE NAME	PROPERTY FILE NAME (.BP1;.BP2)	CONFIGURATION FILE NAME (.CSV)	NOTES
Honeywell	QS7700A	BCS7700	N/A	N/A	
Honeywell	QS7800A	7800 SERIES Control	N/A	N/A	
Honeywell	QS7800C	QM40XX Data Acquisition Module	ON REQUEST	QM40XX	Data Acquisition Modules
Armstrong	QS7800D	Trapscan System	ON REQUEST	ON REQUEST	
Honeywell	QS7800E	PulsaFeeder PULSAtrol	PULSA	PULSA	
Honeywell	QS7800A	S7830 Expanded Annunciator	S7830	S7830	Expanded Annunciator
Honeywell	QS7800A	S7800 Keyboard/Display Module	S7800	S7800	
Honeywell	QS7800A	ST7800 Relay Module	ST7800		Requires S7800 module
Honeywell		RM7800E,G,L,M Relay Modules	RM78XX	RM78XX	
Honeywell		RM7840E,G,L,M Relay Modules	RM78XX	RM78XX	
Honeywell	N/A, this is the chassis that the above modules plug into	Q7700A,B			
CB-Link	833-2727	Display Module	N/A	N/A	
CB-Link	833-2729	Data Control Bus Module	N/A	N/A	
CB-Link	833-2734	CB 783	ON REQUEST	ON REQUEST	Requires 833-2727 or 833-2729 on module
CB-Link	833-2734	CB 780	ON REQUEST	ON REQUEST	Requires 833-2727 or 833-2729 on module
CB-Link	833-2734	CB 784	ON REQUEST	ON REQUEST	Requires 833-2727 or 833-2729 on module
CB-Link	833-2425	CB-Hawk	Hawk	Hawk	Requires 833-2727 or 833-2729 on module

Note: SYSNet is the generic name for networks of the above modules. Controlbus is the generic name for the networks in a NIM/CBLink configuration.



Revision History

Date	Resp	Format	Driver Ver.	Doc. Rev.	Comment
6/15/04	Meg	Meg	1.00	1	Changed to new format. Added new revision table. Added connection diagram. Changed connection information (DUR0318).
12/29/04	JD		1.00	2	Releasing